

EVERSOURCE

PETITION FOR JOINT OR IDENTICAL POLE LOCATIONS

To the Town Council of Amherst, Massachusetts.

NSTAR ELECTRIC COMPANY DBA EVERSOURCE ENERGY and VERIZON NEW ENGLAND, INC. request permission to locate a line of poles, wires, cables and fixtures, including the necessary sustaining and protecting fixtures to be owned and used in common by your petitioners, along and across the following public way:

Location – Eversource is requesting permission to install three (3) jointly owned poles on Harkness Road. The first to be set is 13/49M, placed in line with and approximately 143 feet southerly of existing pole 13/49. The second is 12/50M to be placed in line with and approximately 142 feet from existing pole 13/50. The third pole is 13/51M to be placed in line with and approximately 146 feet from pole 13/51. All poles are approximately 19 feet from road center line to pole center line.

Reason – Circuit is being converted for reliability purposes.

Wherefore they pray that after due notice and hearing as provided by law, they be granted joint or identical locations for and permission to construct and maintain a line of poles, wires and cables, together with such sustaining and protecting fixtures as they may find necessary, said poles to be erected substantially in accordance with the field plan herewith and made a part hereof marked **6A030567**.

Also for permission to lay and maintain underground laterals, cables and wires in the above or intersecting public ways for the purpose of making connections with such poles and buildings as each of said petitioners may desire for distributing purposes.

Your petitioners agree to reserve space for one crossarm at a suitable point on each of said poles for the fire and police telephone signal wires belonging to the municipality and used by it exclusively for municipal purposes.

NSTAR ELECTRIC COMPANY DBA EVERSOURCE ENERGY

By 

District Representative

VERIZON NEW ENGLAND, INC.

Albert E. Bessette

By _____

Manager Right-of-Way

Dated this 12th day of May 2020

TOWN COPY



ORDER FOR JOINT OR IDENTICAL POLE LOCATIONS

By the Board of Selectmen of the Town of Amherst, Massachusetts.

Notice having been given and a public hearing held, as provided by law,
IT IS HEREBY ORDERED

that NSTAR ELECTRIC COMPANY DBA EVERSOURCE ENERGY and VERIZON NEW ENGLAND, INC. be and they are hereby granted joint or identical locations for and permission to construct and maintain a line of poles and their respective wires and cables to be placed thereon, together with such sustaining and protecting fixtures as said Companies may deem necessary, in the public way hereinafter referred to, as requested in petition of said Companies dated the 12th day of May, 2020.

All construction under this order shall be in accordance with the following conditions:

Poles shall be of sound timber, and reasonably straight, and shall be set substantially at the points indicated upon the plan marked **6A030567** filed with and made a part of said petition. There may be attached to said poles by said EVERSOURCE not to exceed 18 wires and 2 cables, and by VERIZON NEW ENGLAND INC. not to exceed 40 wires and 4 cables, and all of said wires and cables shall be placed at a height of not less than 18 feet from the ground at highway crossings, and not less than 12 feet from the ground elsewhere.

The following is the public way along which the poles above referred to may be erected, and the number of poles which may be erected thereon under this order:

Location – Eversource is requesting permission to install three (3) jointly owned poles on Harkness Road. The first to be set is 13/49M, placed in line with and approximately 143 feet southerly of existing pole 13/49. The seconds is 12/50M to be placed in line with and approximately 142 feet from existing pole 13/50. The third pose is 13/51M to be placed in line with and approximately 146 feet from pole 13/51. All poles are approximately 19 feet from road center line to pole center line.

Reason – Circuit is being converted for reliability purposes.

Also, that permission be and thereby is granted to each of said Companies to lay and maintain underground laterals, cables and wires in the above or intersecting public ways for the purpose of making connections with such poles and buildings as each may desire for distributing purposes.

I hereby certify that the foregoing order was adopted at a meeting of the Board of Selectmen of the Town of Amherst, Massachusetts held on the _____ day of _____, 2020.

Clerk of Selectmen

We hereby certify that on _____ 2020, at _____ o'clock _____ M,

at _____ a public hearing was held on the petition of the NSTAR ELECTRIC COMPANY DBA EVERSOURCE ENERGY and VERIZON NEW ENGLAND INC. for permission to construct the line of poles, wires, cables, fixtures and connections described in the order herewith recorded, and that we mailed at least seven days before said hearing a written notice of the time and place of said hearing to each of the owners of real estate (as determined by the last preceding assessment for taxation) along the way upon which the Companies are permitted to construct the line of poles, wires, cables, fixtures and connections under said order. And that thereupon said order was duly adopted.

Board of Selectmen of the town of Amherst, Massachusetts.

CERTIFICATE

I hereby certify that the foregoing is a true copy of a joint location order and certificate of hearing with notice adopted by the Board of Selectmen of the Town of Amherst, Massachusetts, on the _____ day of _____ 2020 and recorded with the records of location orders of said town, Book _____, Page _____. This certified copy is made under the provisions of Chapter 166 of General Laws and any additions thereto or amendments thereof.

Attest:

Town Clerk

TOWN COPY

LEGEND


- ⊗ PROPOSED JOINT POLE
- PROPOSED EVERSOURCE POLE
- ⊗ EXISTING JOINT POLE
- EXISTING EVERSOURCE POLE
- ⊗ EXISTING EVERSOURCE POLE TO BE JOINT
- ⊗ EXISTING FOREIGN POLE TO BE JOINT
- PROPOSED PAD MOUNT TRANSFORMER
- ▣ EXISTING PAD MOUNT TRANSFORMER
- ⌈⌋ EXISTING MANHOLE
- UG EXISTING CONDUIT
- UG PROPOSED CONDUIT
- ⊕ PROPOSED HANDHOLE
- ⊗ EXISTING HANDHOLE
- ANCHOR
- ⊙ PROPOSED SILO
- ⊗ EXISTING SILO
- HEXHOLE

PROPRIETARY INFORMATION: THE INFORMATION ON THIS MAP SHALL BE CONSIDERED PROPRIETARY TO EVERSOURCE AND THE USER (WHICH SHALL BE DEFINED AS ANY PERSON OR ENTITY WHO HAS RECEIVED THE MAP THROUGH SALE, PURCHASE, EXCHANGE, GIFT OR OTHERWISE) SHALL KEEP IT IN CONFIDENCE AND SHALL NOT FURNISH OR DISCLOSE IT TO ANY THIRD PARTY WITHOUT PRIOR WRITTEN PERMISSION OF EVERSOURCE UTILITIES.

EVERSOURCE
ENERGY

POLE PETITION
256 TO 166 HARKNESS ROAD
AMHERST

DATE	CIRCUIT	VOLTAGE	WORK ORDER	WORK REQUEST
4/15/20	17R2	13.8KV	64030367	3404180
SCALE	NTS	DRAWN BY C. TROSINO-LARAMY		

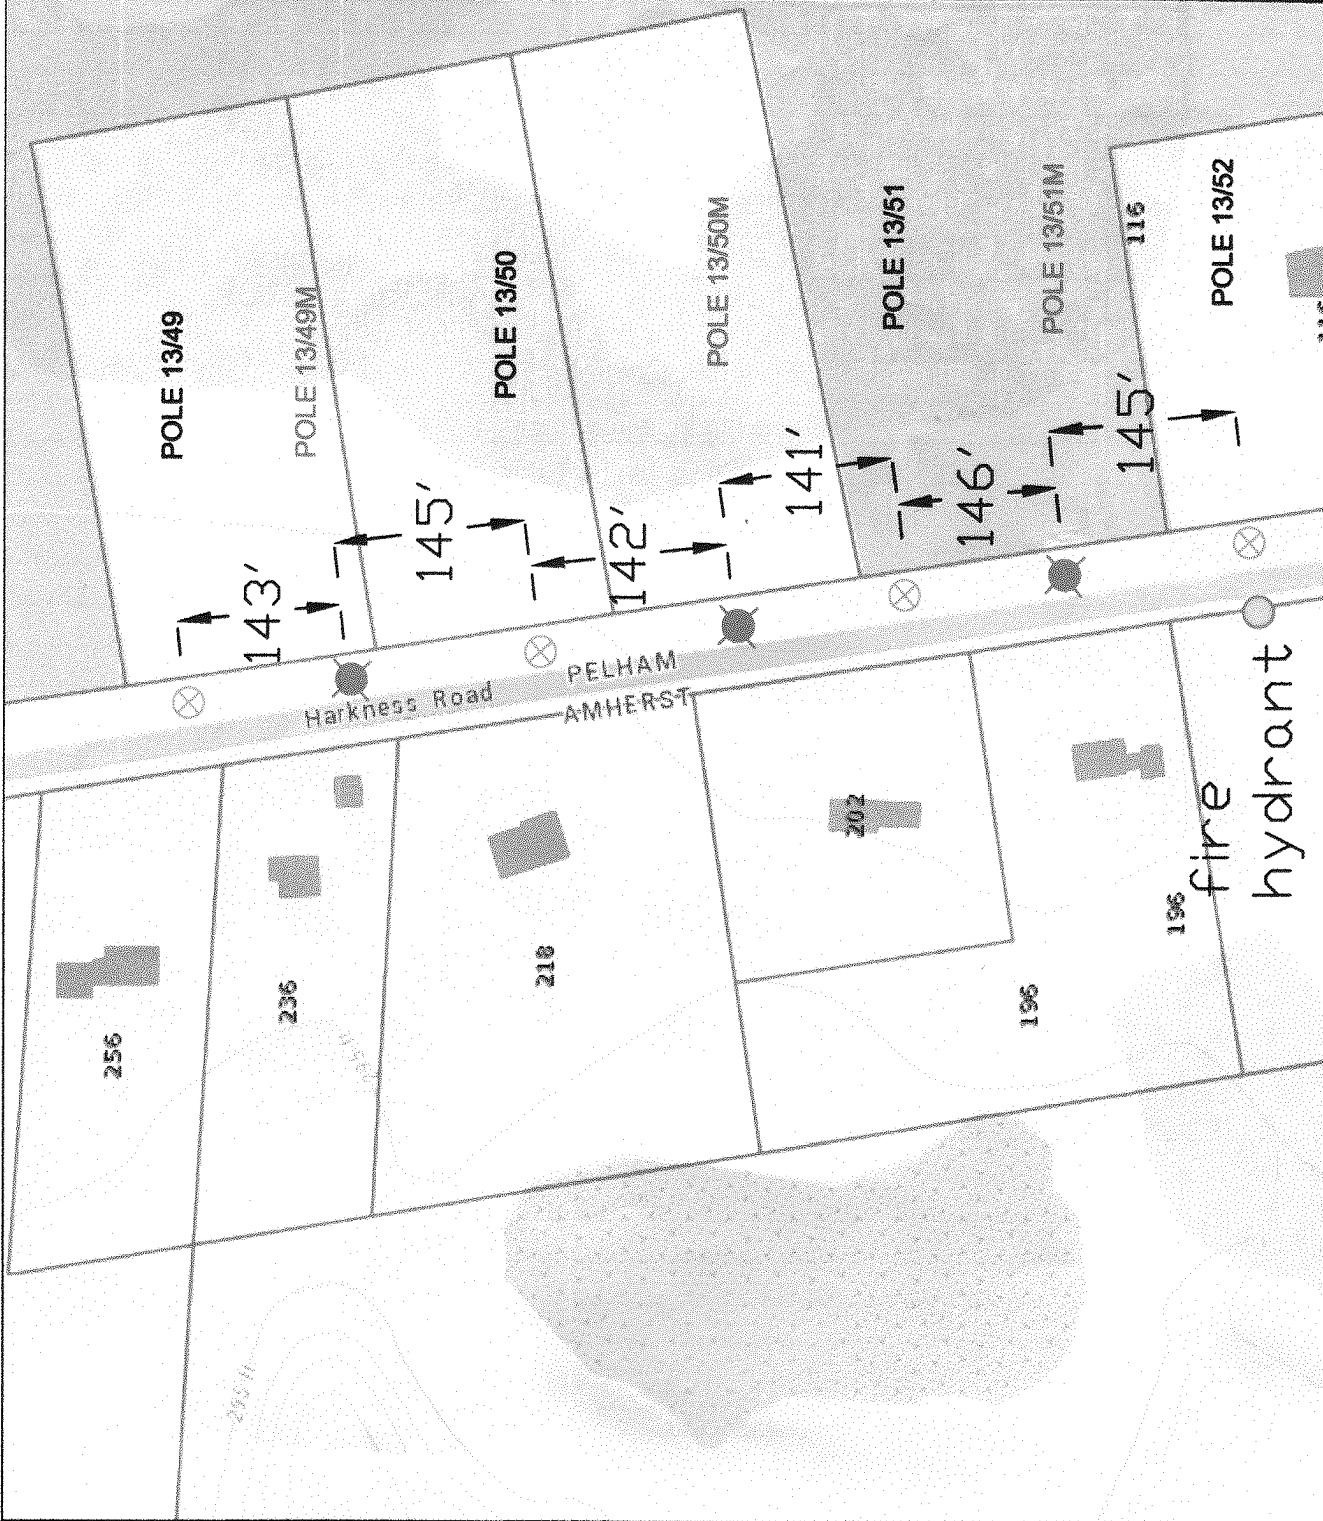

PURPOSE AND DESCRIPTION:

EVERSOURCE IS REQUESTING PERMISSION TO INSTALL (3) JOINTLY OWNED POLES ON HARKNESS RD, AMHERST. THE FIRST TO BE SET IS 13/49M, PLACED IN LINE WITH AND APPROXIMATELY 143' SOUTH OF EXISTING POLE 13/49. THE SECOND IS 13/50M TO BE PLACED IN LINE WITH AND APPROXIMATELY 142' FROM EXISTING POLE 13/50, THE THIRD POLE IS 13/51M TO BE PLACED IN LINE WITH AND APPROXIMATELY 146' FROM POLE 13/51. ALL POLES ARE APPROXIMATELY 19' FROM ROAD CENTER LINE TO POLE CENTER LINE